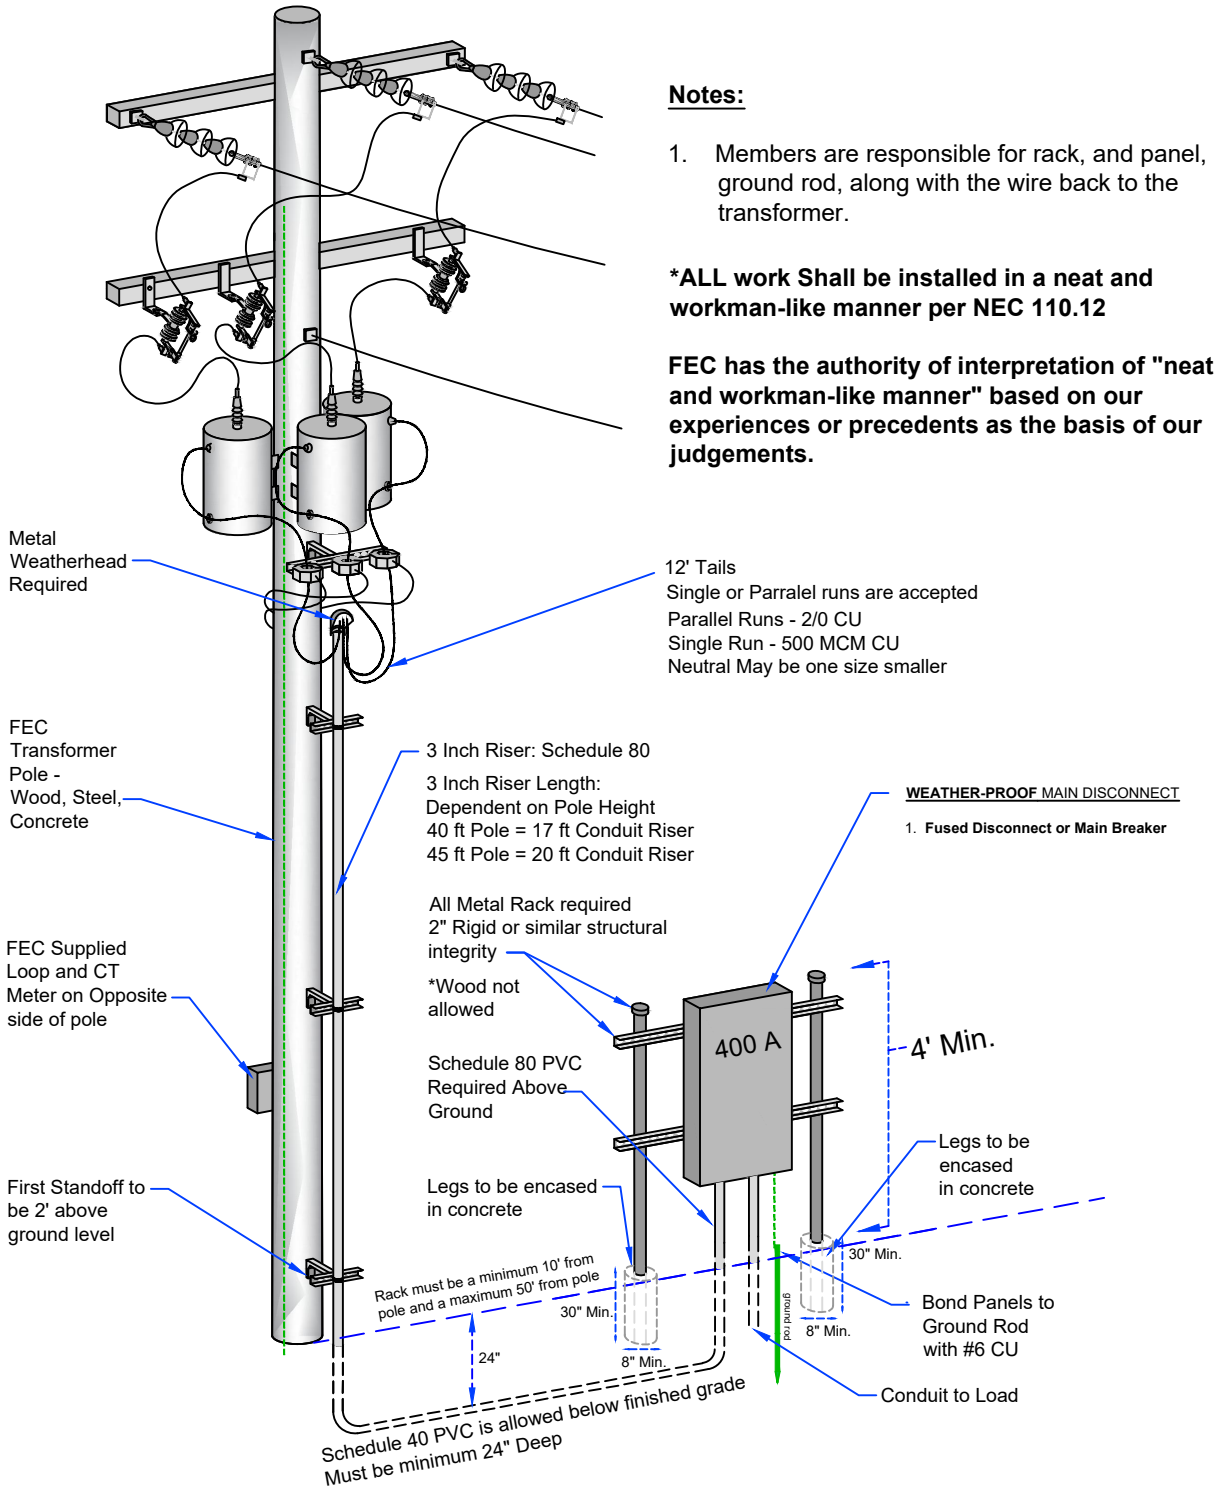

Notes:

1. Members are responsible for rack, and panel, ground rod, along with the wire back to the transformer.

***ALL work Shall be installed in a neat and workman-like manner per NEC 110.12**

FEC has the authority of interpretation of "neat and workman-like manner" based on our experiences or precedents as the basis of our judgements.

DATE: 3/20/2025

FAYETTE ELECTRIC COOPERATIVE, INC.
Your Touchstone Energy® Cooperative

Three Phase 400 Amp Service Rack - off Transformer Pole

Phone	(979) 968-3181 1-866-968-3181	MS-60