


ALL work Shall be installed in a neat and workman-like manner per NEC 110.12

FEC has the authority of interpretation of "neat and workman-like manner" based on our experiences or precedents as the basis of our judgements.

Notes:

1. Members are responsible for rack, panels, ground rod, gutter and conduit, along with wire from panel to tails at weather head.
2. Wiring, installation, and materials must conform to the requirements of the NEC, TDLR, and NESC.

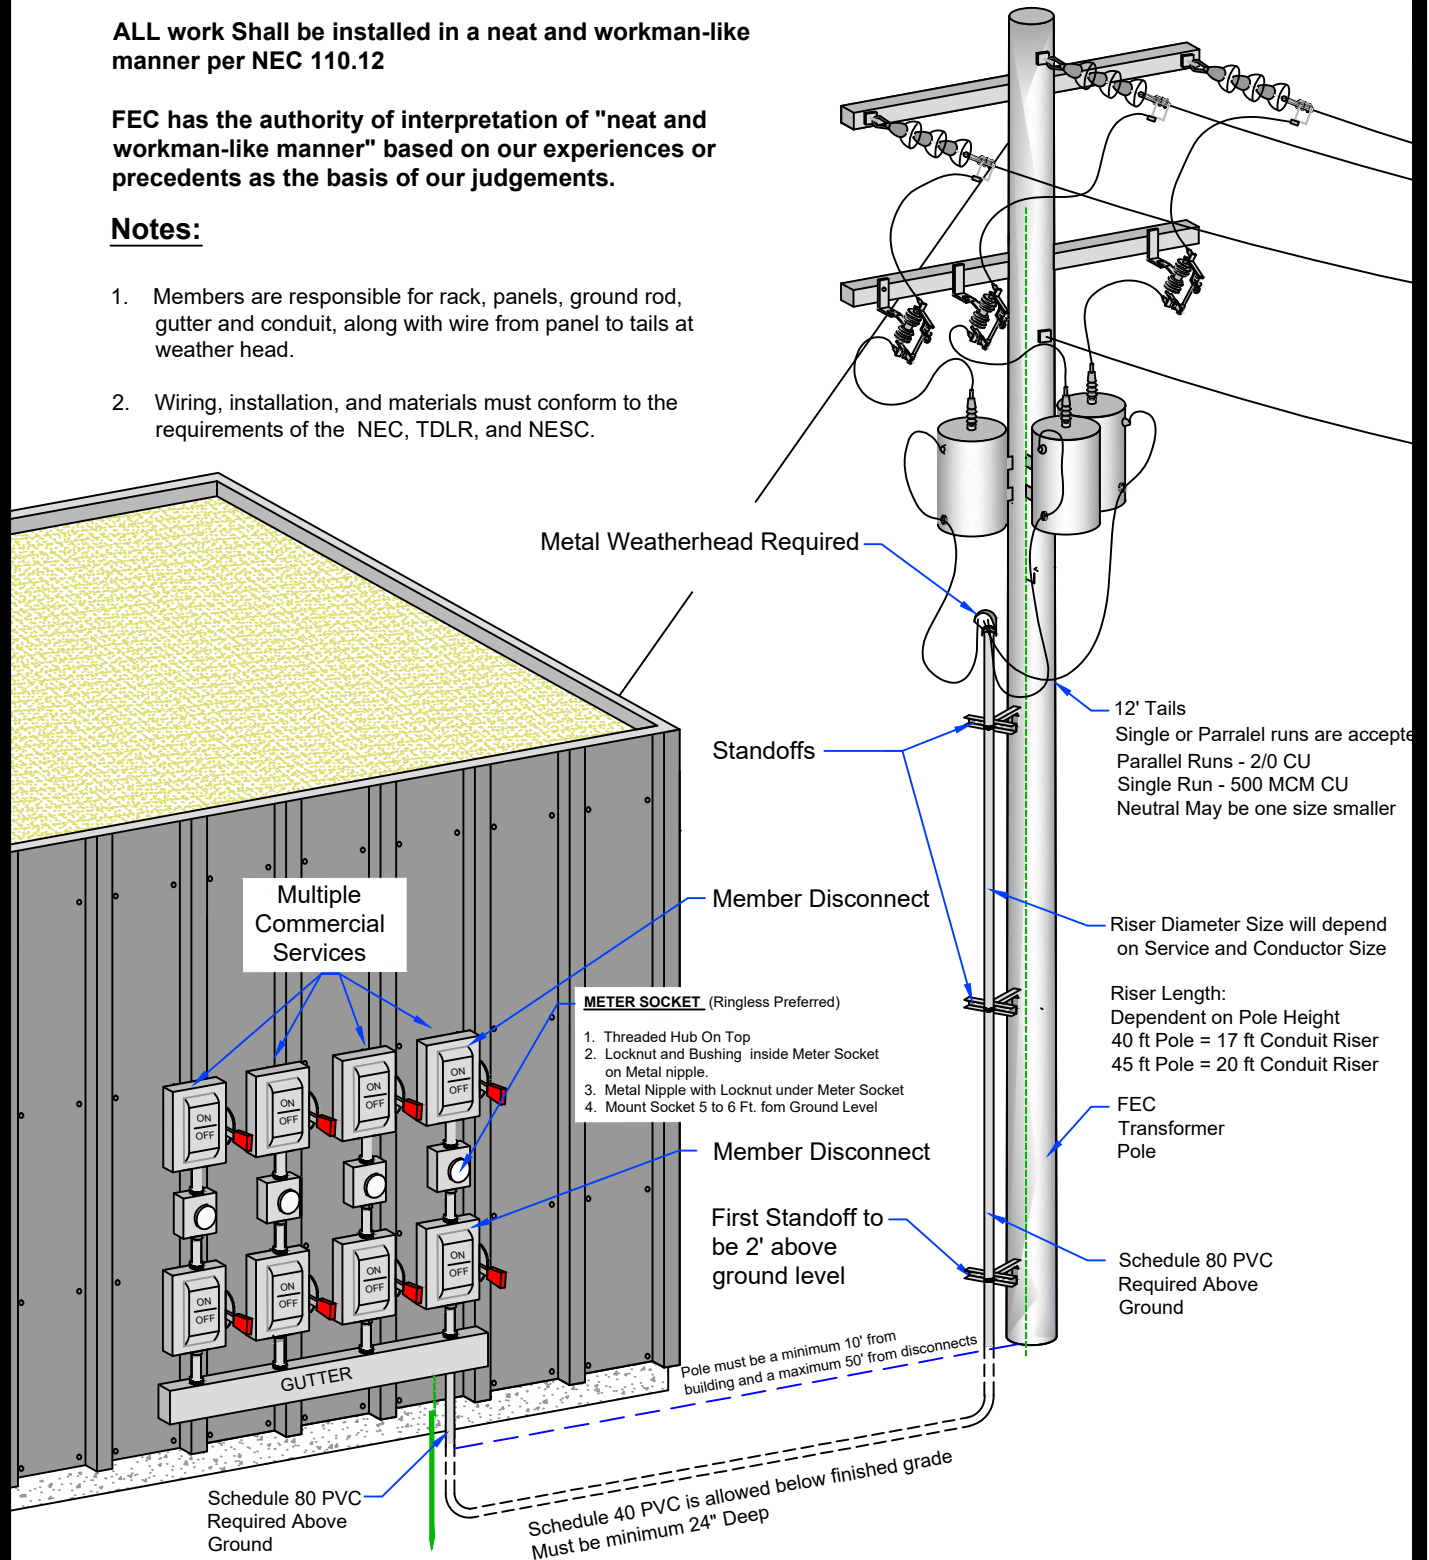

DATE: 3/20/2025



Three Phase Service - Commercial Building
Meter Loop Specifications - Voltage:480 - With FEC & Member Disconnects

Phone

(979) 968-3181 1-866-968-3181

MS-70